

## Evaluation Report "Kasselwood Metal Shingle" Metal Roof Assembly

### Manufacturer:

#### Kassel & Irons

(A division of Isaiah Industries)  
8510 Industry Park Drive  
Piqua, OH 45356  
(800) 543-8938

*for*

### Florida Product Approval

#### # FL 11858.1 R1

### Florida Building Code 2010

#### Per Rule 9N-3

Method: 1 - D

Category: Roofing

Sub - Category: Metal Roofing

Product: "Kasselwood Metal Shingle"

Material: Steel


Support: Wood Deck

### Prepared by:

James L. Buckner, P.E., SECB  
Florida Professional Engineer # 31242  
Florida Evaluation ANE ID: 1916  
Project Manager: Diana Galloway  
Report No. 11-202-KWS-S9W-ER  
Date: 11 / 24 / 11

#### Contents:

Evaluation Report Pages 1 – 7

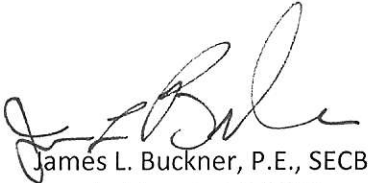

James L. Buckner, P.E., SECB  
Florida P.E. # 31242

12/13/11

CBUGK, Inc.

1399 N. Killian Drive, Suite 4, West Palm Beach, Florida 33403  
Phone: (561)491-9927 Fax: (561)491-9928 Website: [www.cbuckinc.net](http://www.cbuckinc.net)

<b>Manufacturer:</b>	<b>Kassel &amp; Irons</b>
<b>Product Name:</b>	<b>Kasselwood Metal Shingle</b>
<b>Product Category:</b>	Roofing
<b>Product Sub-Category</b>	Metal Roofing
<b>Compliance Method:</b>	State Product Approval Rule 9N-3.005 (1) (d)
<b>Product/System Description:</b>	“Kasselwood Metal Shingle” Steel roof panel, with a wood shake or slate appearance, mechanically attached to Wood Deck.
<b>Product Assembly as Evaluated:</b>	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none"><li>1. Roof Panel</li><li>2. Fasteners</li><li>3. Underlayment</li></ol>
<b>Support:</b>	<b>Type:</b> Wood Deck (Design of support and its attachment to support framing is outside the scope of this evaluation.) <b>Description:</b> <ul style="list-style-type: none"><li>• 15/32” or greater plywood,</li><li>• or Wood plank (min. specific gravity of 0.42)</li></ul>
<b>Slope:</b>	Minimum slope shall be 3:12 in accordance with FBC Section 1507.5.2, applicable code sections and manufacturer’s recommendations.
<b>Performance:</b>	Wind Uplift Resistance: <ul style="list-style-type: none"><li>• Design Uplift Pressure: (Refer to “Table A” attachment details herein)</li></ul> <b>METHOD 1: - 74.75 PSF</b> <b>METHOD 2: - 127.8 PSF</b> <b>METHOD 3: - 161 PSF</b>

- Performance Standards:** The product described herein has demonstrated compliance with:
- UL 580-06 – *Test for Uplift Resistance of Roof Assemblies*
  - UL 1897-04 – *Uplift test for roof covering systems*
  - TAS 125-03 – *Standard Requirements for Metal Roofing Systems*
- Standards Equivalency:** The UL 580-94 & UL 1897-98 standard version used to test the evaluated product assembly is equivalent with the prescribed standards in UL 580-06 & UL 1897-04 adopted by the Florida Building Code 2010.
- Code Compliance:** The product described herein has demonstrated compliance with Florida Building Code 2010, Section 1504.3.2.
- Evaluation Report Scope:** This building envelope product is evaluated for compliance with the structural wind load requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 9N-3.001.
- Limitations and Conditions of Use:**
- Scope of “Limitations and Conditions of Use” for this evaluation:  
This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 9N-3.005. Per Rule 9N-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”.
  - Option for application outside “Limitations and Conditions of Use”  
Rule 9N-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
  - Design of support system is outside the scope of this report.
  - Fire Classification is outside the scope of Rule 9N-3, and is therefore not included in this evaluation.
  - This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)
- Quality Assurance:** The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 9N-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Farabaugh Testing & Engineering** (FBC Organization ID# QUA 7733)

**Components &  
Materials:  
(by Manufacturer)**

**Roof Panel:**

Material: Steel  
Thickness: 29 gauge (min.)  
Panel Width: 8-5/8" nominal (max.) Coverage  
Panel Length: 40-5/8" nominal  
Rib Height: 1/2" nominal  
Yield Strength: 37 ksi min.  
Corrosion Resistance: Per FBC Section 1507.4.3

**Kasselwood Metal Shingle**

**Anchor Strip:**

Material: Steel  
Thickness: 29 gauge (min.)

**Fasteners:**

FASTENER 1:

Type: Ring Shank Roofing Nails  
Size: 1-1/4"  
Corrosion Resistance: Per FBC Section 1506.5  
Standard: Per ASTM F 1667

FASTENER 2:

Type: Low Profile-Head Wood Screw  
Size: #10 x 1"  
Corrosion Resistance: Per FBC Section 1506.6 and 1507.4.4  
Per ANSI/ASME B18.6.1

FASTENER 3:

Type: HWH A Hiform lag screw  
Size: #14 - 8 x 1"  
Corrosion Resistance: Per FBC Section 1506.6 and 1507.4.4

**Underlayment:**

Per roofing manufacturer's guidelines in compliance with FBC Sections 1507.5.2.1 and 1507.5.3.

**Installation:**

**Installation Method:**

(Refer to "TABLE A" below and drawings on Pages 6-7 of this evaluation report.)

1. Install the Shingle to the deck starting at the eave.
2. Install Anchor Strip into Edge Flashing at the eave with fasteners spaced maximum 8" o.c. along the eave.
3. The first course of shingles shall fully engage the Anchor Strip.
4. Install the shingles to the deck with panel fasteners through the tab guide holes spaced 9.8" o.c., along the width of the shingle,.
5. The male end of the shingle is then tucked in the female end of the previous shingle to form a lock. Interlocking ribs of the shingle must be fully engaged.
6. Install shingles in a staggered pattern.

TABLE "A"			
	METHOD 1:	METHOD 2:	METHOD 3:
<b>Design Pressure:</b>	<b>- 74.75 PSF</b>	<b>- 127.8 PSF</b>	<b>- 161 PSF</b>
Fastener Spacing Across Shingle width:	9.8"	9.8"	9.8"
Fastener:	Ring Shank Nail (Refer to Pg 4)	Low Profile Screw (Refer to Pg 4)	Lag Screw (Refer to Pg 4)
# Fasteners per Nail Tab:	1	2	1

Install the "Kasselwood Metal Shingle" roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 2010. The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.


**Referenced Data:**

1. TAS 125-03 (Per UL 580 & UL 1897) Uplift Test  
By Hurricane Test Laboratory, LLC (FBC Organization #TST ID: 1527)  
Report #: 0360-0410-06, Report Date: 5/24/06
2. TAS 125-03 (Per UL 580 & UL 1897) Uplift Test  
By Hurricane Test Laboratory, LLC (FBC Organization #TST ID: 1527)  
Report #: 0360-0812-04, Report Date: 3/08/05
3. Equivalency of Test Standard Certification  
By James L. Buckner, P.E. @ CBUGK Engineering  
(FBC Organization # ANE 1916)
4. Quality Assurance  
By Farabaugh Testing & Engineering (FBC Organization ID# QUA 7733)
5. Certification of Independence  
By James L. Buckner, P.E. @ CBUGK Engineering  
(FBC Organization # ANE 1916)


**Installation Method  
Kassel & Irons**

**"Kasselwood Metal Shingle" (29 gauge Steel) Roof Panel attached to Wood Deck**

Drawings

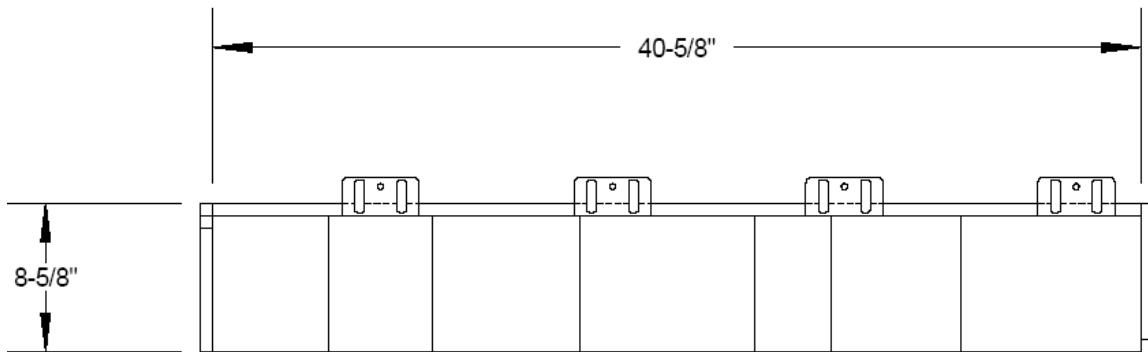


**Typical Panel Profile**

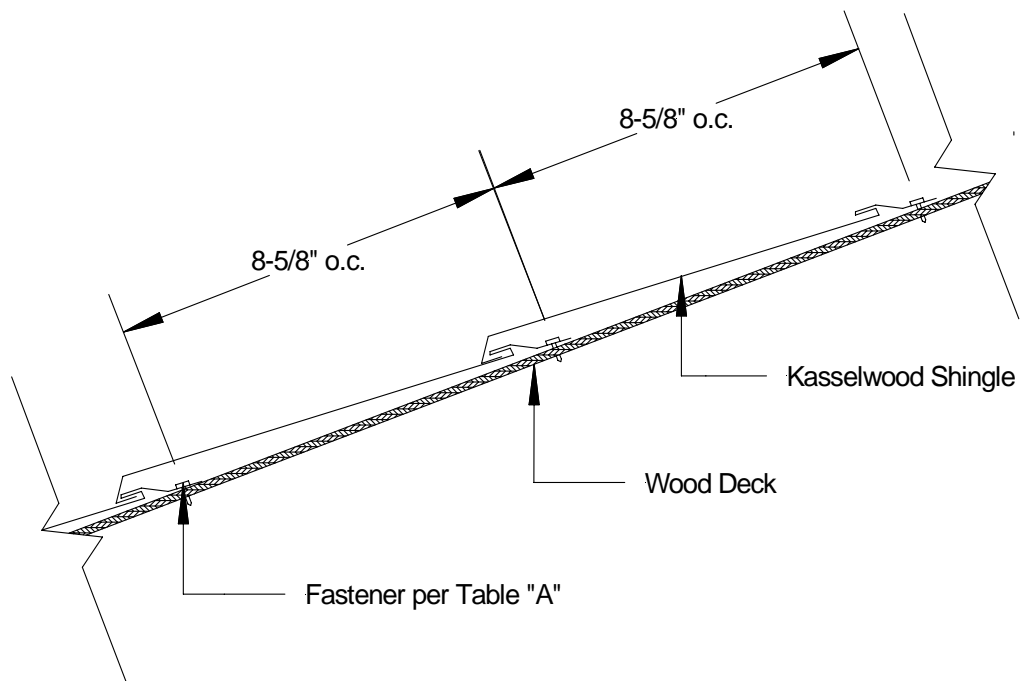

**Assembly Profile Section View**

## Installation Method Kassel & Irons

### “Kasselwood Metal Shingle” (29 gauge Steel) Roof Panel attached to Wood Deck

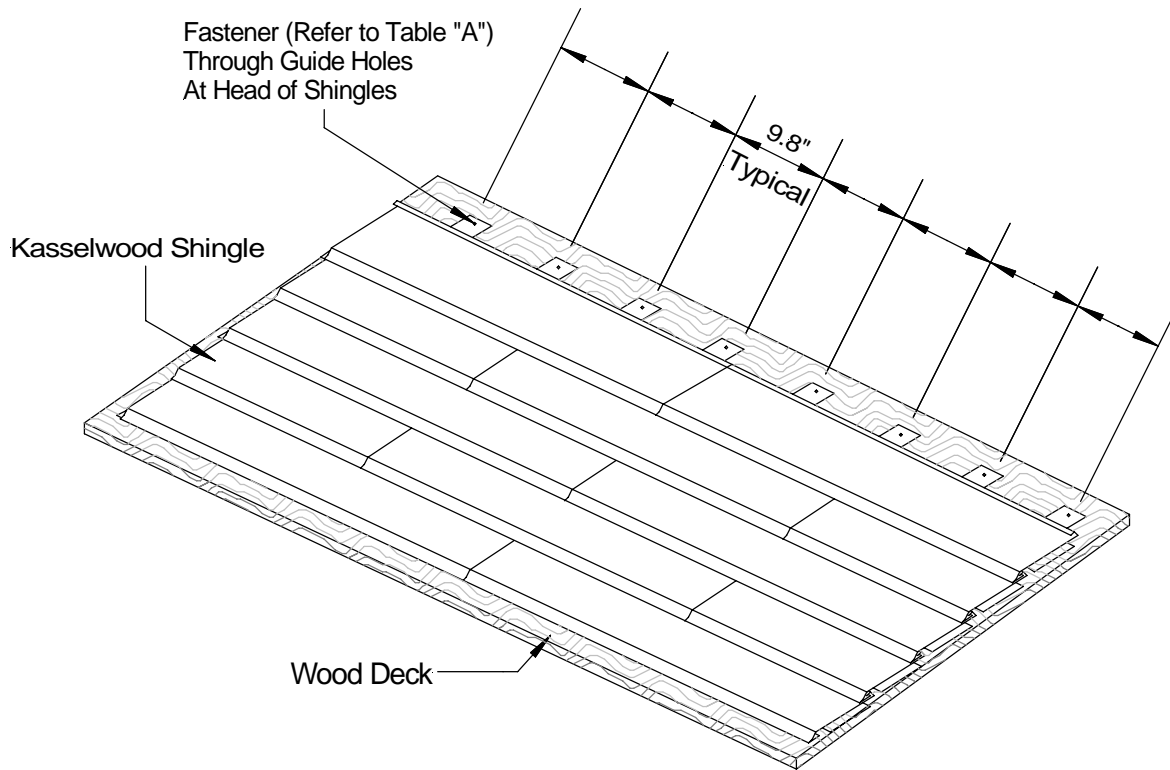

**Typical Roof Assembly Isometric View**

TABLE "A"			
	METHOD 1:	METHOD 2:	METHOD 3:
<b>Design Pressure:</b>	- 74.75 PSF	- 127.8 PSF	- 161 PSF
Fastener Spacing Across Shingle width:	9.8"	9.8"	9.8"
Fastener:	Ring Shank Nail (Refer to Pg 4)	Low Profile Screw (Refer to Pg 4)	Lag Screw (Refer to Pg 4)
# Fasteners per Nail Tab:	1	2	1